



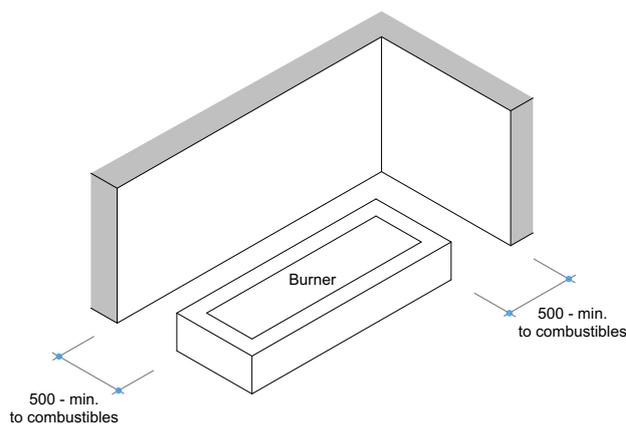

**GD10 - 1400**

**Specifications**

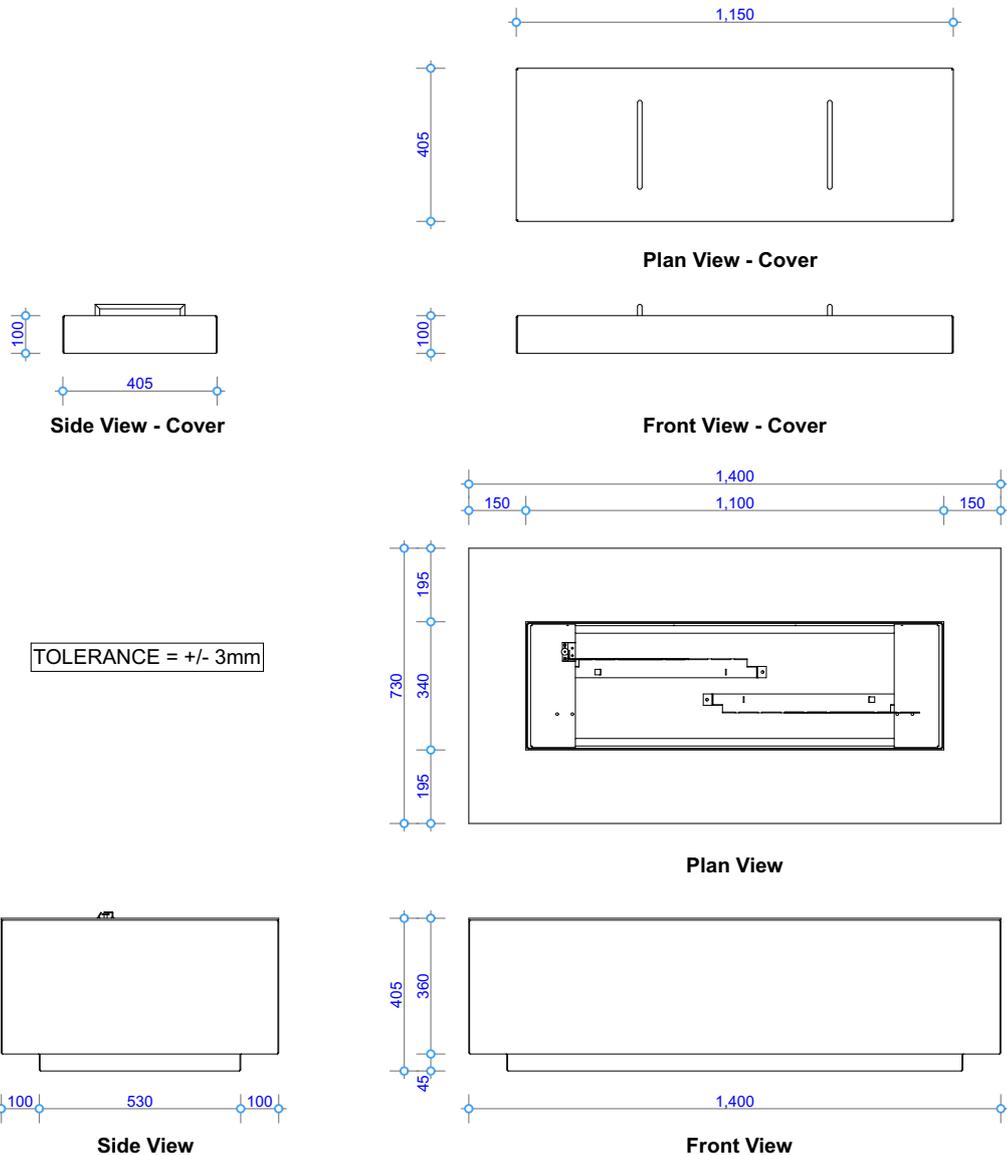


**Fire Installation - Trim Sizes**  
 NOTE: Confirm fixing holes on site prior to drilling

COPYRIGHT ©  
 THIS DRAWING IS THE PROPERTY  
 OF **The Fire Dept.**

Client: THE FIRE DEPT.		
Product: GD10-1400		
Title: BURNER TABLE DIMENSIONS & CAVITY CLEARANCES		
Drawn: SR	Date: 27/02/2017	
Chkd: JW	Date: 27/02/2017	
Appd: JW	Date: 27/02/2017	
Scale: on A4		



Drawing No.	<b>GD10-1400-901</b>	Sheet 01 of 02	Revision <span style="border: 1px solid black; padding: 2px;">1</span>
-------------	----------------------	----------------	--

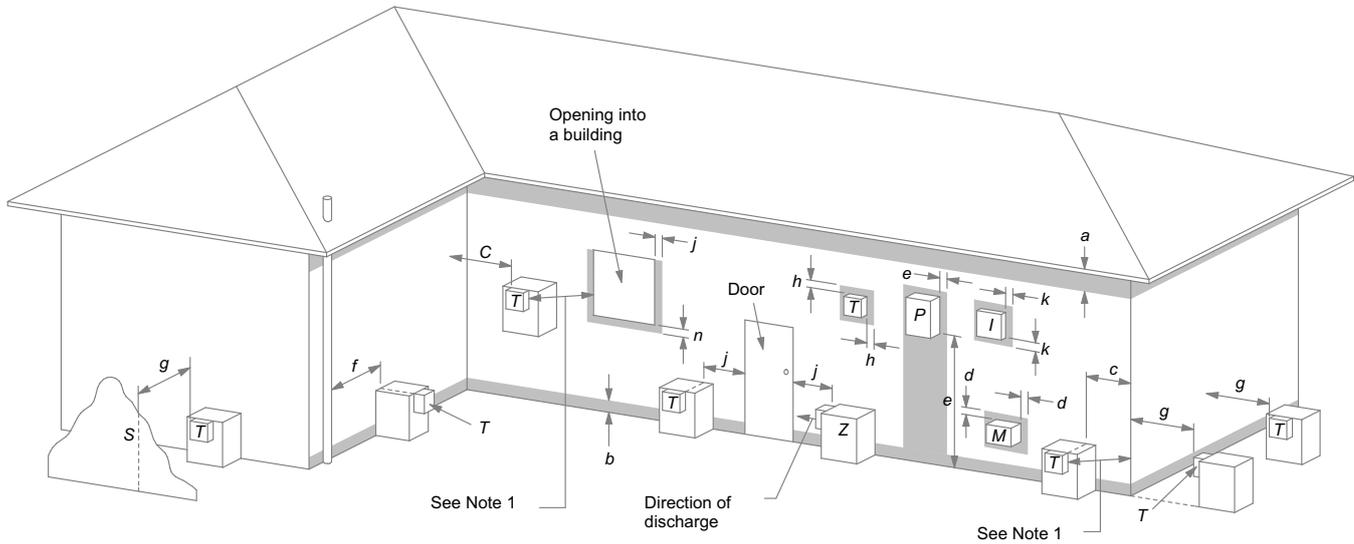

**LEGEND:**  
 I = Mechanical air inlet  
 M = Gas meter  
 P = Electricity meter or fuse box  
 S = Structure  
 T = Flue terminal  
 Z = Fan-assisted appliance only

a = 200      g = 500  
 b = 300      h = 300  
 c = 300      j = 300 (at window) & 1500  
 d = 1000      (fan-assisted appliance by the door)  
 e = 500      k = 1000  
 f = 75        n = 500

**NOTES:**  
 1 Where dimensions *c, j or k* cannot be achieved an equivalent horizontal distance measured diagonally from the nearest discharge point of the terminal to the opening may be deemed by the *Technical Regulator* to comply.

Shading indicates prohibited area for flue terminals

**Location of Flue Terminals of Balanced Flue, Room-Sealed, Fan-Assisted or Outdoor Appliances**

**NOTE:** To be read in conjunction with AS/NZS 5601.1:2013

COPYRIGHT ©  
 THIS DRAWING IS THE PROPERTY  
 OF The Fire Dept.

Client: THE FIRE DEPT.		
Product: GD10-1400		
Title: FLUE EXIT CLEARANCES		
Drawn: SR	Date: 27/02/2017	
Chkd: JW	Date: 27/02/2017	
Appd: JW	Date: 27/02/2017	
Scale:		on A4



Drawing No.	<b>GD10-1400-902</b>	Sheet 02 of 02	Revision 1
-------------	----------------------	----------------	------------