THE FIRE DEPT.
HAND CRAFTED FIRES

GD6-1200 Exposed Burner

Specifications

Information in this specification may be subject to change without notice. Please ensure you have the current version before beginning installation.

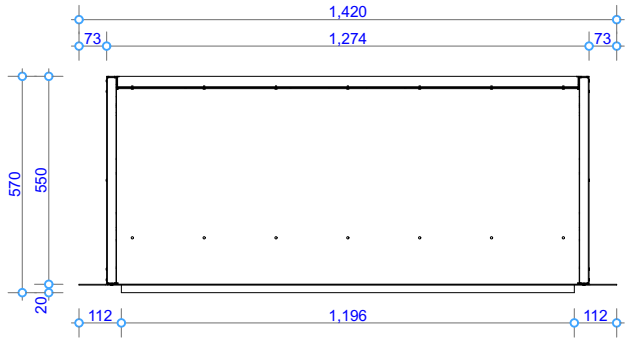

Plan View

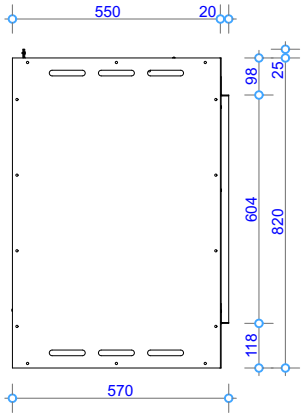

Side View

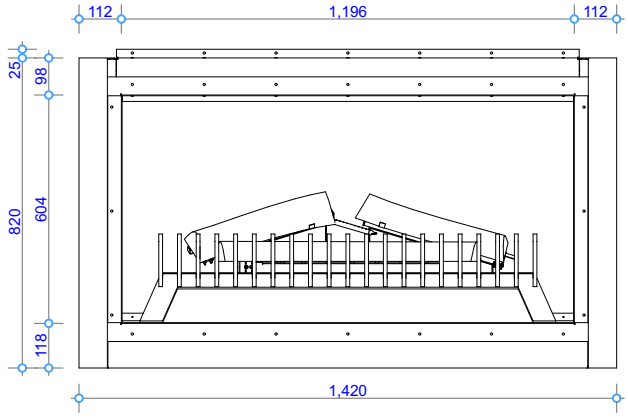

Front View

TOLERANCE = +/- 3mm

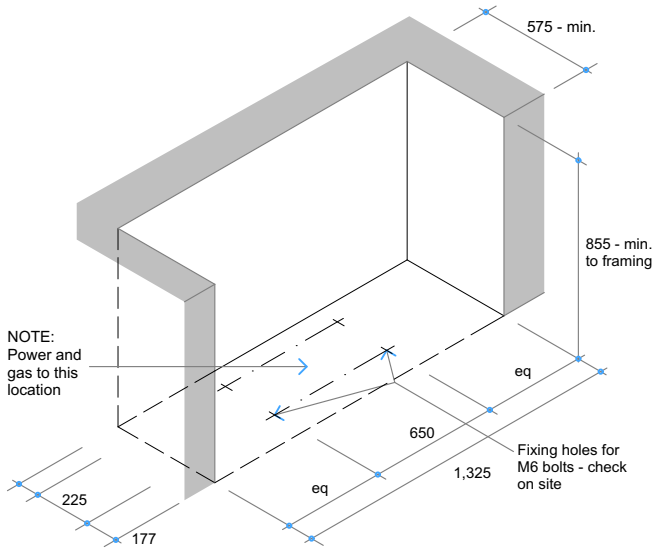

Fire Installation - Trim Sizes

NOTE: Confirm fixing holes on site prior to drilling.
The cavity (that the fire box is to be installed) must be weather tight and comply with the requirements of the New Zealand Building Codes Clause E2 (External Moisture).

COPYRIGHT© THIS DRAWING IS THE PROPERTY OF **The Fire Dept.**

Client: THE FIRE DEPT.			
Product: GD6-1200-Exposed Burner			
Title: FIREBOX DIMENSIONS			
Drawn: SR	Date: 27/03/2018		
Chkd: JW	Date: 27/03/2018		
Appd: JW	Date: 27/03/2018	Scale: on	A4
Drawing No. GD6-1200-901EB		Sheet 01 of 04	Revision 1

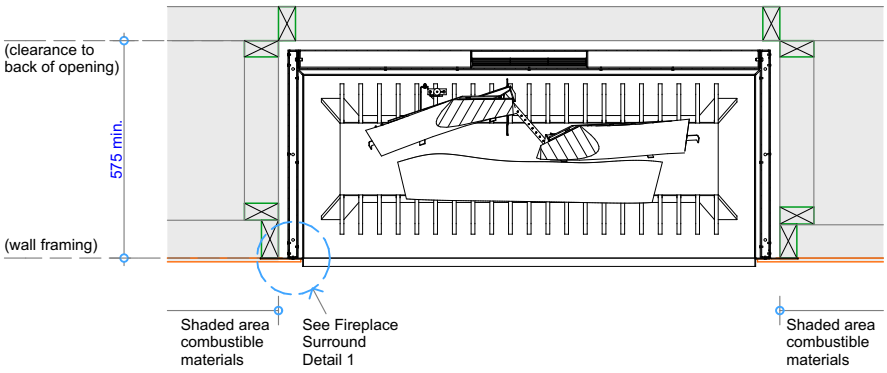

Plan View - Fire Insert

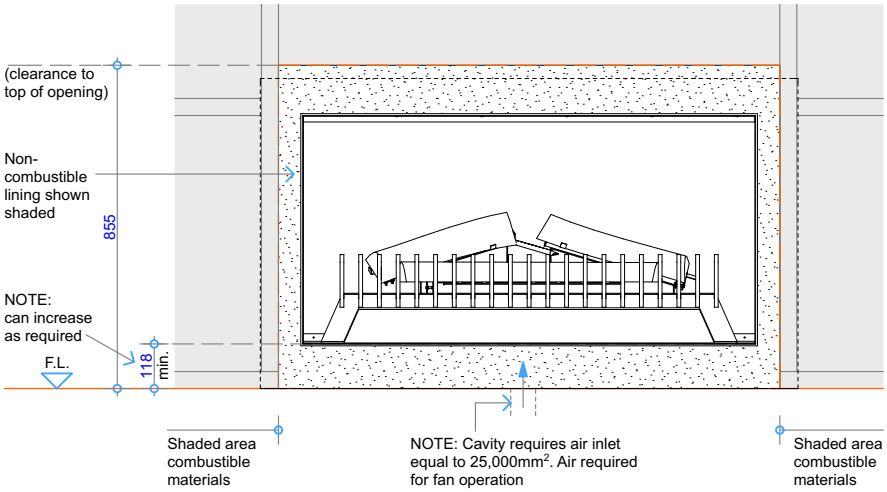

Front View - Fire Insert

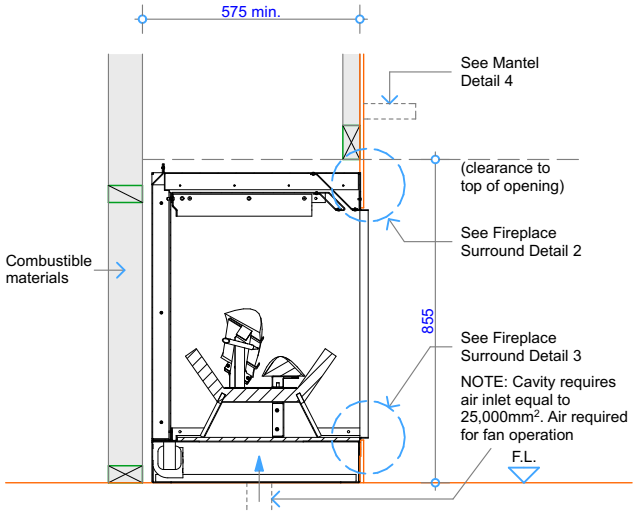

Cross Section - Fire Insert at Floor Level

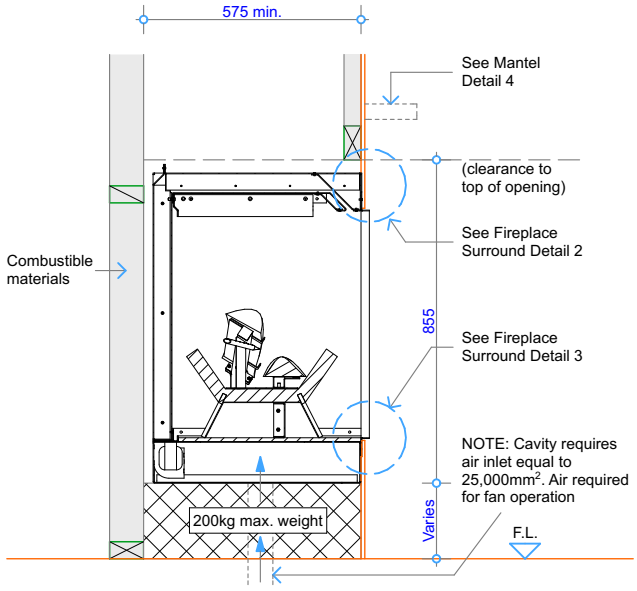

Cross Section - Fire Insert on Plinth

NOTE: Plinth height can vary to suit

COPYRIGHT© THIS DRAWING IS THE PROPERTY OF **The Fire Dept.**

Client: THE FIRE DEPT.			
Product: GD6-1200-Exposed Burner			
Title: CAVITY CLEARANCES			
Drawn: SR	Date: 27/03/2018		
Chkd: JW	Date: 27/03/2018		
Appd: JW	Date: 27/03/2018	Scale: on A4	

THE FIRE DEPT.

Drawing No. GD6-1200-902EB	Sheet 02 of 04	Revision 1	

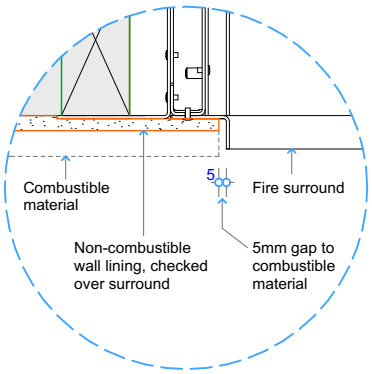

Detail 1 - Plan View Fire Surround

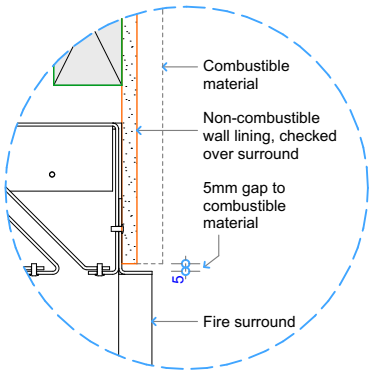

Detail 2 - Top of Fire to Combustible Materials

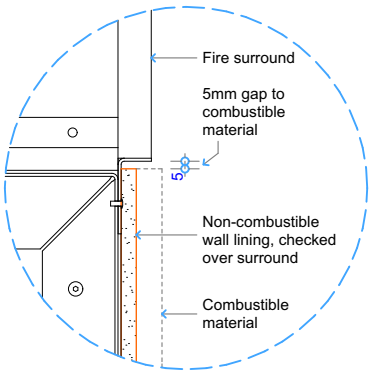

Detail 3 - Bottom of Fire to Floor

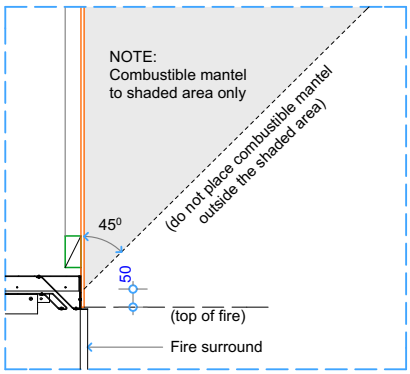

Detail 4 - Top of Fire to Combustible Mantel

COPYRIGHT©
THIS DRAWING IS THE PROPERTY OF **The Fire Dept.**

Client: THE FIRE DEPT.			
Product: GD6-1200-Exposed Burner			
Title: SURROUND DETAILS			
Drawn: SR	Date: 27/03/2018		
Chkd: JW	Date: 27/03/2018		
Appd: JW	Date: 27/03/2018	Scale: on A4	
Drawing No. GD6-1200-903EB		Sheet 03 of 04	Revision 1

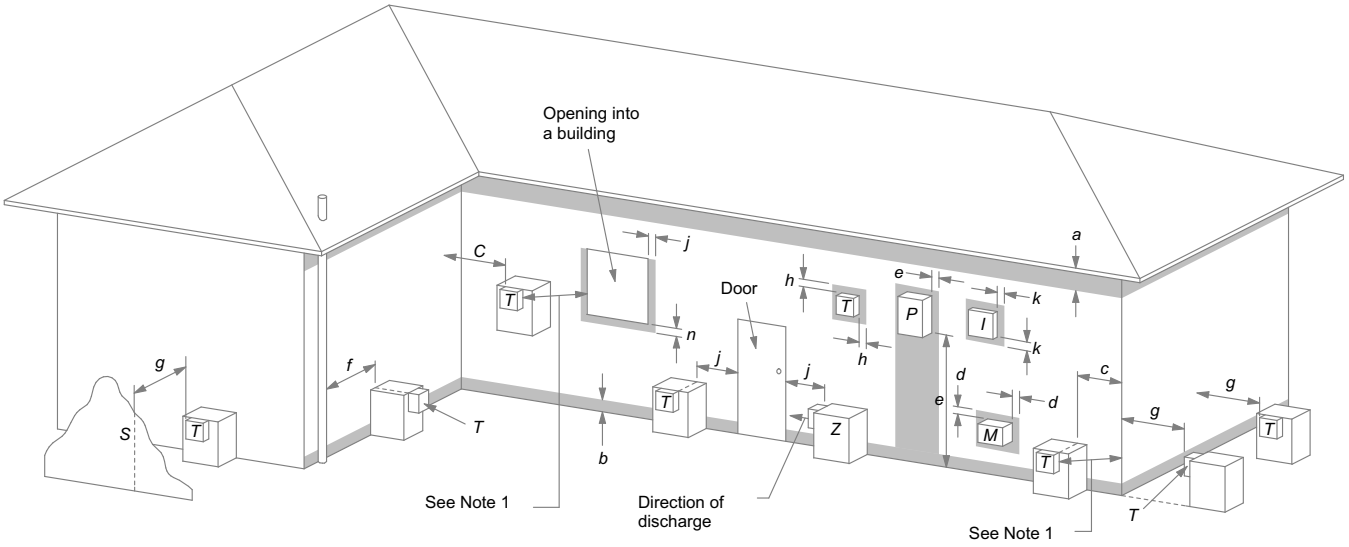

LEGEND:
I = Mechanical air inlet
M = Gas meter
P = Electricity meter or fuse box
S = Structure
T = Flue terminal
Z = Fan-assisted appliance only

Shading indicates prohibited area for flue terminals

a = 200
b = 300
c = 300
d = 1000
e = 500
f = 75
g = 500
h = 300
j = 300 (at window) & 1500 (fan-assisted appliance by the door)
k = 1000
n = 500

NOTES:
1 Where dimensions *c, j or k* cannot be achieved an equivalent horizontal distance measured diagonally from the nearest discharge point of the terminal to the opening may be deemed by the *Technical Regulator* to comply.

Location of Flue Terminals of Balanced Flue, Room-Sealed, Fan-Assisted or Outdoor Appliances

NOTE: To be read in conjunction with AS/NZS 5601.1:2013

COPYRIGHT©
THIS DRAWING IS THE PROPERTY OF **The Fire Dept.**

Client: THE FIRE DEPT.			
Product: GD6-1200-Exposed Burner			
Title: FLUE EXIT CLEARANCES			
Drawn: SR	Date: 27/03/2018		
Chkd: JW	Date: 27/03/2018		
Appd: JW	Date: 27/03/2018	Scale: on A4	
Drawing No. GD6-1200-904EB		Sheet 04 of 04	Revision 1