









**GD10-1400**

**Specifications**

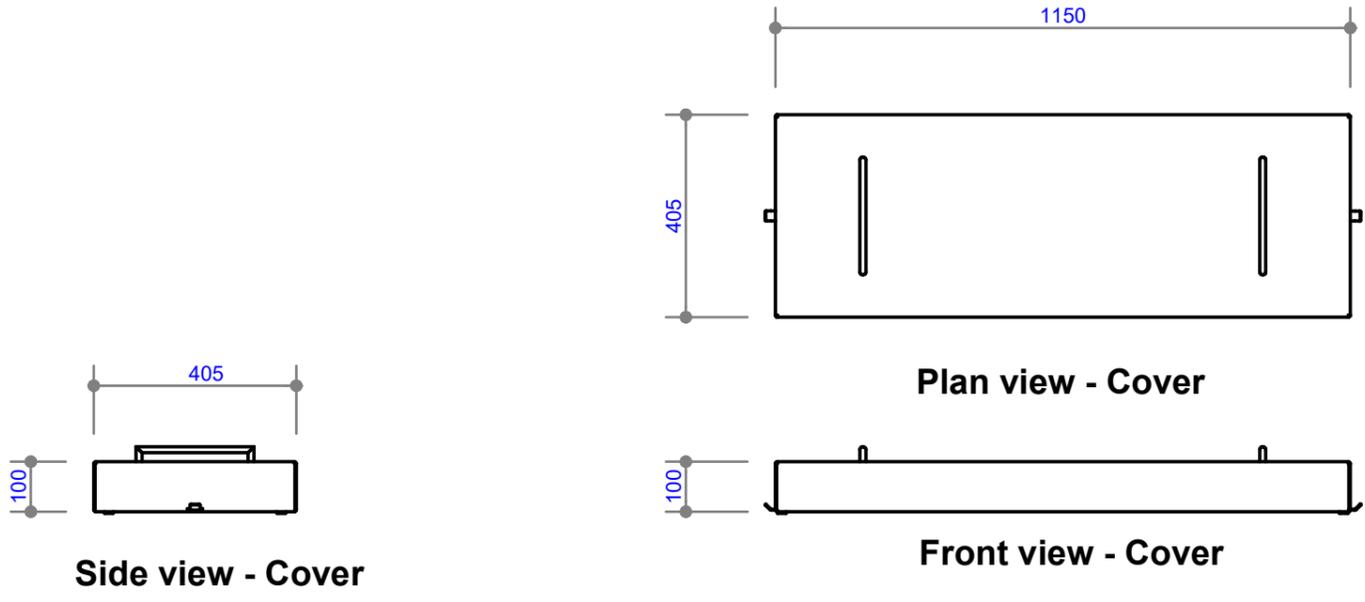

NOTE:  
Gas and power supply  
from below. Location  
within marked area.

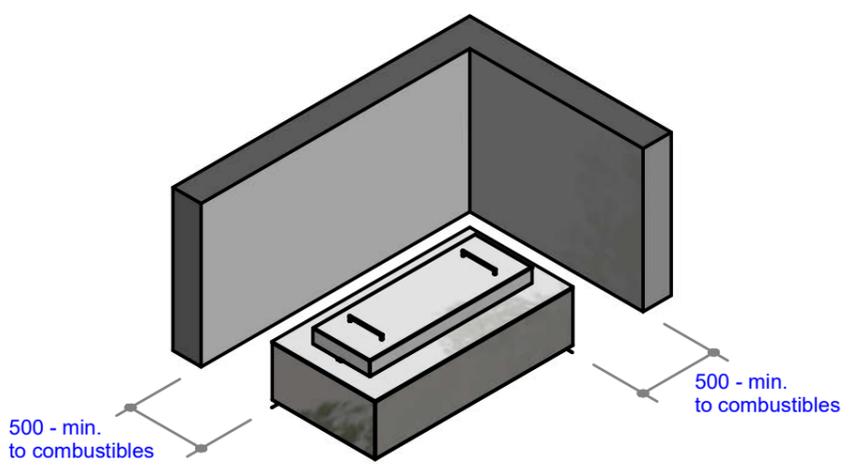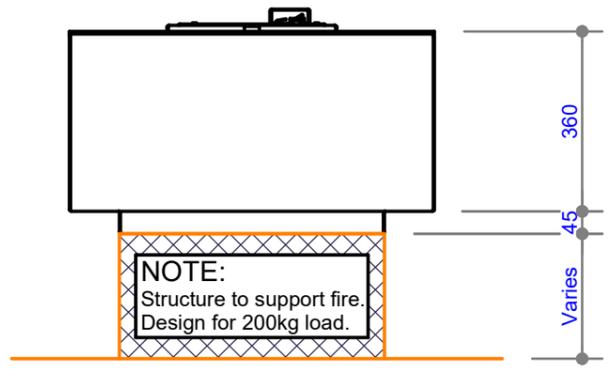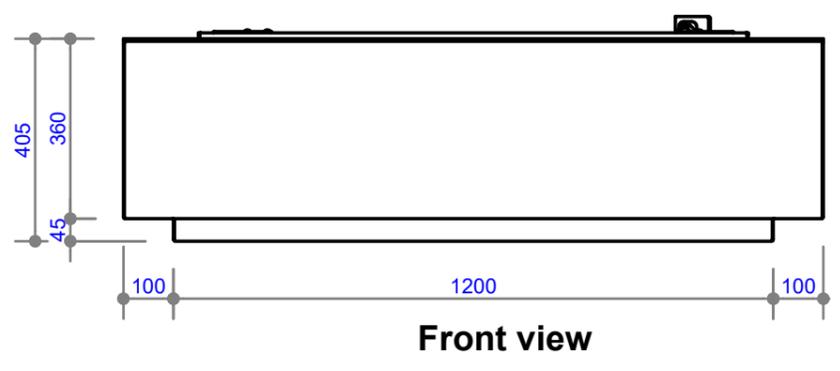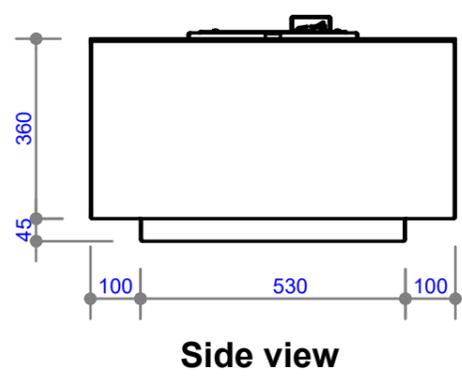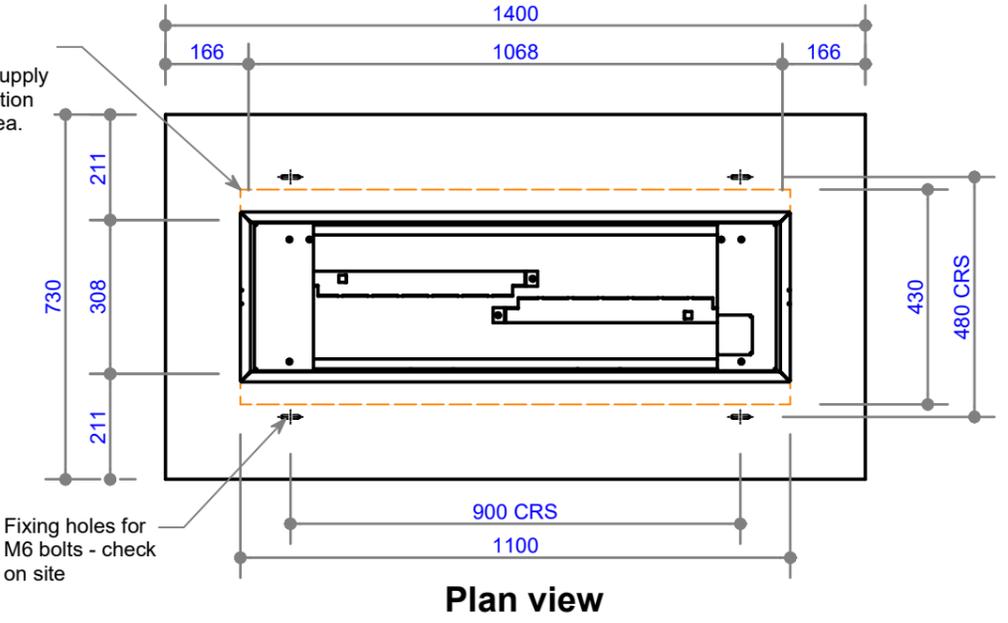


**Fire installation - Trim sizes**  
NOTE: Confirm fixing holes on site prior to drilling

COPYRIGHT©  
THIS DRAWING IS THE PROPERTY  
OF The Fire Dept.

Client: THE FIRE DEPT.		
Product: GD10-1400		
Title: BURNER TABLE DIMENSIONS & CAVITY CLEARANCES		
Drawn: J.SCHOEMAN	Date: 20/09/2018	
Chkd: J. WILSON	Date: 20/09/2018	
Appd: J. WILSON	Date: 20/09/2018	
Scale: on A4		



Drawing No. <b>GD10-1400-901</b>	Sheet 1 of 2	Revision <b>2</b>
----------------------------------	--------------	-------------------

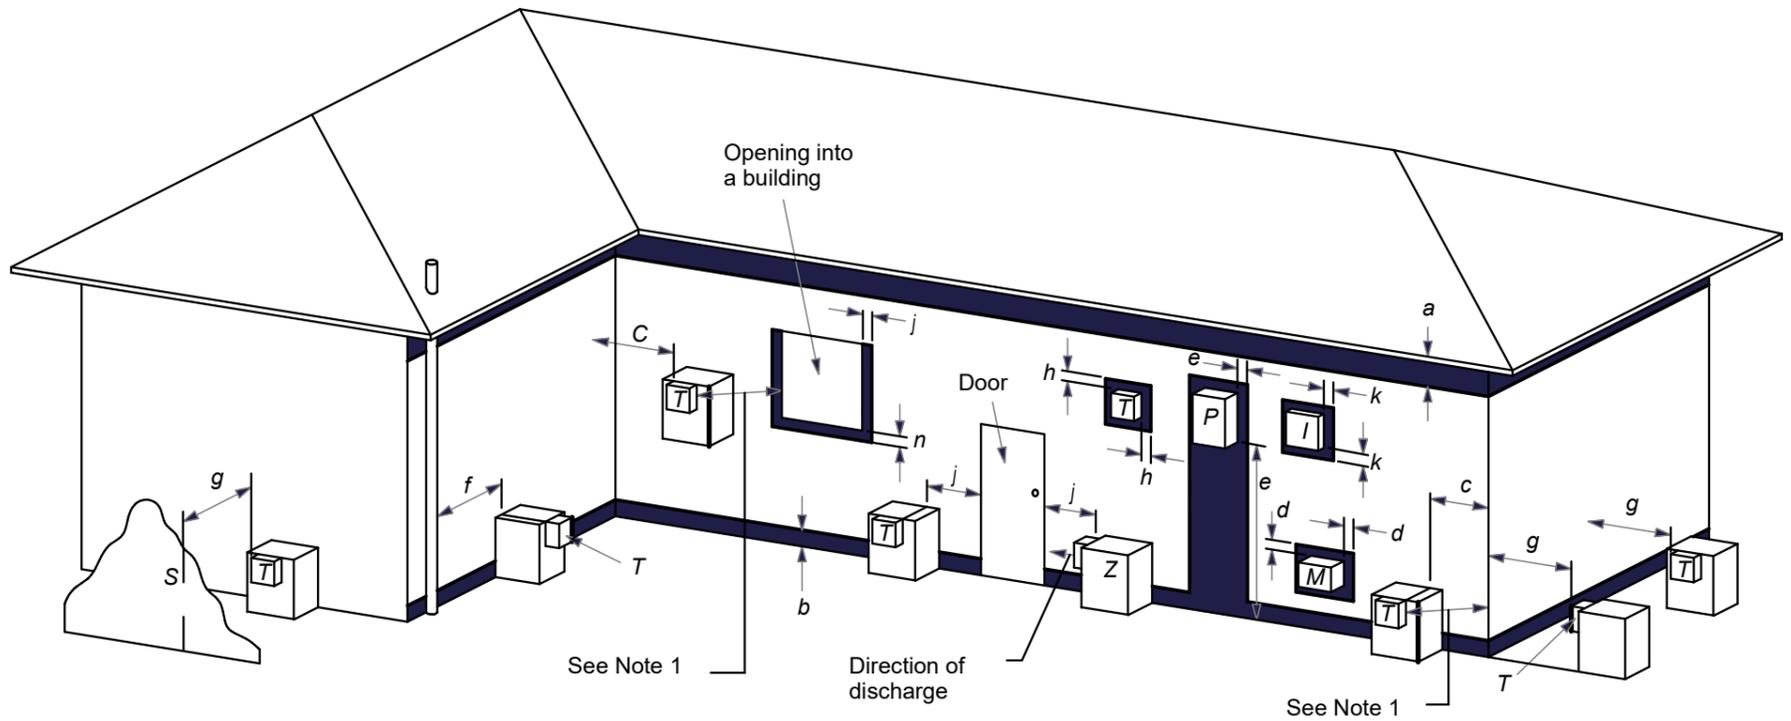

LEGEND:  
 I = Mechanical air inlet  
 M = Gas meter  
 P = Electricity meter or fuse box  
 S = Structure  
 T = Flue terminal  
 Z = Fan-assisted appliance only

a = 200      g = 500  
 b = 300      h = 300  
 c = 300      j = 300 (at window) & 1500  
                   (fan-assisted appliance by the door)  
 d = 1000     k = 1000  
 e = 500      n = 500  
 f = 75


NOTES:  
 1 Where dimensions c, j or k cannot be achieved an equivalent horizontal distance measured diagonally from the nearest discharge point of the terminal to the opening may be deemed by the Technical Regulator to comply.

Shading indicates prohibited area for flue terminals

**Location of Flue Terminals of Balanced Flue, Room-Sealed, Fan-Assisted or Outdoor Appliances**

**NOTE:** To be read in conjunction with AS/NZS 5601.1:2013

COPYRIGHT©  
 THIS DRAWING IS THE PROPERTY  
 OF The Fire Dept.

Client: THE FIRE DEPT.		
Product: GD10-1400		
Title: FLUE EXIT CLEARANCES		
Drawn: J.SCHOEMAN	Date: 20/09/2018	 Scale:            on A4
Chkd: J. WILSON	Date: 20/09/2018	
Appd: J. WILSON	Date: 20/09/2018	



Drawing No. <b>GD10-2000-902</b>	Sheet 2 of 2	Revision <b>2</b>
----------------------------------	--------------	-------------------